



## Meridian® 2141 Series Siphon Jet Toilet - Wall Outlet



2141-W-2-RM

Fixture May Show Some Available Options



Please visit [www.acorneng.com](http://www.acorneng.com) for most current specifications.

### Siphon Jet Toilet

**Meridian® Toilet** contoured Housing features an attractive, satin finish and are optionally available with a High Polish Finish (-HP) for an exceptional, elegant appearance. The standard Toilet Bowl has a matte finish on the inside. Mounting is available for front or rear installations. All units include punching for an elongated Hinged Seat. (-HS Hinged Seat is optionally available.) Housing includes Access Panel on each side for installation of fixture and Hinged Seat.

**Toilet** is a Siphon Jet type with an elongated Bowl manufactured to ASME A112.19.3-2008 and CSA B45.4-2008 requirements and will flush with a minimum of 25 PSI flow pressure when used in conjunction with a minimum of 1.28 GPF. P-Trap has a minimum 3-1/2" Seal and will pass a 2-1/8" Ball and is fully enclosed.

**Flush Valve** supply is available for exposed or concealed Flush Valve styles with 1-1/2" NPT connection.

**Front Mount (-FM)** unit includes a fixture-to-wall Mounting Plate with exposed vandal-resistant fasteners. Mounting Plate is mounted directly to a reinforced wall or to optional -MC Mounting Carrier (6" bolt centers) for off-floor, Front Mount models. Waste Outlet connection for Front Mount (-FM) unit is 5-1/2" diameter recessed Gasket Flange.

**Rear Mount (-RM)** unit includes integral 1/2" UNC Anchor Tapping and mounting hardware. Unit requires an accessible pipe chase for installation. Waste Outlet connection for Rear Mount (-RM) unit is a 2-3/8" OD stainless steel plain end.

### GUIDE SPECIFICATION

Acorn Meridian® Siphon Jet Toilet (specify model number and options). Fixture to be heavy gage type 304 stainless steel. Exposed surfaces shall be polished to a satin finish. Housing to include side Access Panels and punching for Hinged Seat. Toilet shall meet ASME A112.19.3-2008 and CSA B45.4-2008 requirements and will flush with a minimum of 25 PSI flow pressure when used in conjunction with a minimum of 1.28 GPF. Toilet P-Trap shall have a minimum 3-1/2" seal that shall pass a 2-1/8" diameter Ball and be fully enclosed.



# Meridian®: 2141 Siphon Jet Toilet - Wall Outlet

## WALL THICKNESS AND TYPE (Must Specify)

Thickness \_\_\_\_\_ Type:  Concrete  Block  Steel

## MODEL NUMBER AND OPTIONS SELECTION:

### BASE MODEL NUMBER

2141 Siphon Jet Toilet

### SUPPLY SELECTION (Must Specify)

-T Top (Exposed)  
 -W Wall (Concealed)

### FIXTURE MOUNTING & WASTE (Must Specify)

-1 Off-Floor, Wall Outlet  
 -2 On-Floor, Wall Outlet

### INSTALLATION (Must Specify)

-FM Front Mount  
 -RM Rear Mount

### TOILET SEAT HEIGHT (15" STANDARD)

-ADA 18" Integral Seat Height

### FLUSH VALVE GPFs (Must Specify)

-1.28 GPF (HET)  
 -1.6 GPF (Not Available in California)  
 -3.5 GPF (Not Available in California)

### FLUSH VALVE OPTIONS (Must Specify)

**\*NOTE: FOR FLUSH VALVE ACCESS PANEL OR COVER REFER TO ACORN OPTIONS MODEL #2898 (-W SUPPLY) OR # 2802 (-T SUPPLY).**

-FV Flush Valve, Mechanical (N/A for ADA)  
 -FVBO Flush Valve by Other  
 -FVH Flush Valve, Hydraulic (N/A for Top Supply)  
 -FVL Flush Valve, ADA Lever Handle  
 -MVCFV Time-Trol Flush Valve (N/A for Top Supply)

### TOILET SEAT OPTIONS

-HS-OFLC Hinged Seat, Open Front Less Cover  
 -HS-OFWC Hinged Seat With Cover  
 -LPFS Less Punch for Hinged Seat


### TOILET OPTIONS

-CO1 Cleanout with O-Ring to No-Hub 2-3/8" x 4" (-RM Models Only)  
 -CO1\_3 Cleanout with O-Ring to No-Hub 2-3/8" x 3" (-RM Models Only)  
 -FVT Flush Thru Wall Connector  
 -GW Gasket Waste (Standard on-FM but Optional on -RM)

### PRODUCT OPTIONS

-BL Bedpan Lugs  
 -EGE Enviro-Glaze Color Specify: \_\_\_\_\_ Toilet Exterior Only  
 -FG 14 Gage Housing  
 -HP High Polish Finish (Exterior Only)  
 -MC Mounting Carrier (6" Bolt Centers) (-1-FM Models Only N/A with -ADA option) Metal Template  
 -MT Metal Template  
 -SW Wall Sleeve (-RM Models Only)  
 -TF Transformer, 120VAC to 24VAC (-MVCFV option)

Please visit [www.acorneng.com](http://www.acorneng.com) for most current specifications.

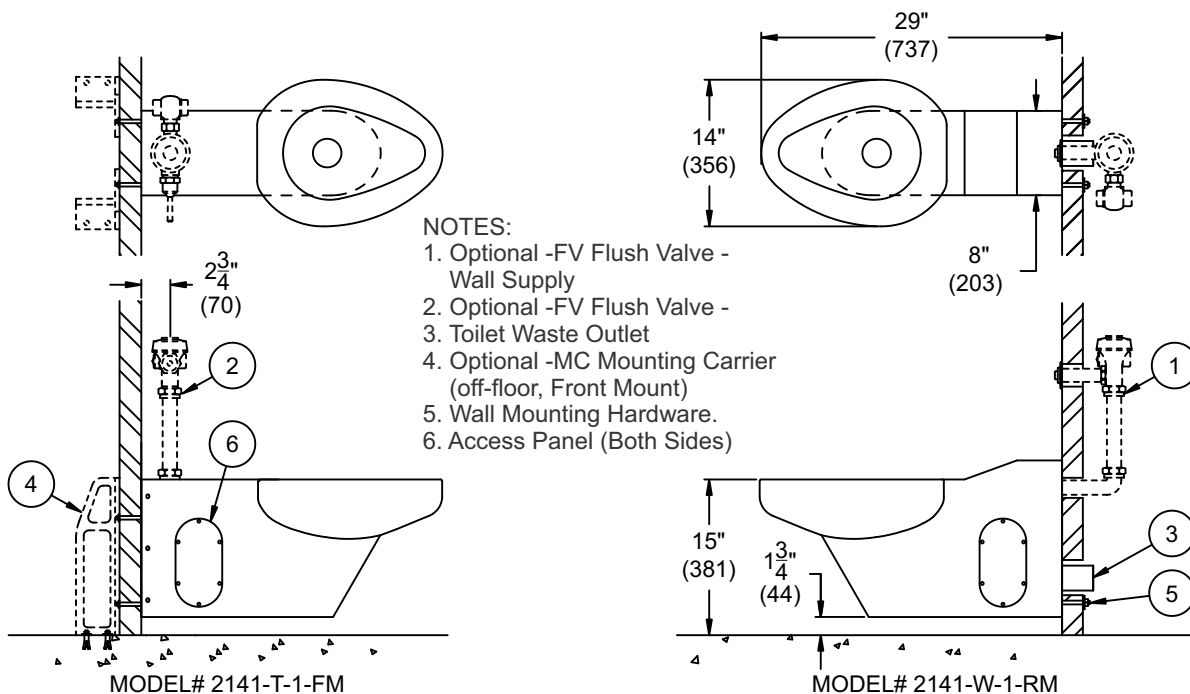

**WARNING:** Cancer and Reproductive Harm - [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

|                                                                                                                                                                                                                                                                                                                                                                           |                                                                                                      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------|
| <p><b>Important:</b> Installation instructions and current rough-in are furnished with each fixture. Do not rough in without certified dimensions. Dimensions are subject to manufacturer's tolerance of plus or minus 1/4" and change without notice. Acorn assumes no responsibility for use of void or superseded data. © Copyright 2009 Acorn Engineering Company</p> |                                                                                                      |
| <p>Selection Summary</p> <p>Model No. &amp; Option _____</p> <p>Quantity _____</p>                                                                                                                                                                                                                                                                                        | <p>Approved for Manufacturing</p> <p>Company _____ Title _____</p> <p>Signature _____ Date _____</p> |