



ACORN SAFETY  
P.O. BOX 3527  
CITY OF INDUSTRY, CA 91744-0527  
**UNITED STATES OF AMERICA**  
[WWW.ACORNSAFETY.COM](http://WWW.ACORNSAFETY.COM)

## **INSTALLATION, OPERATION AND MAINTENANCE INSTRUCTIONS**

### **PEDESTAL EYE/FACEWASH**



**MODELS S0310-FPB/S0320-FPB/S0330-FPB/S0340-FPB**

### **TECHNICAL ASSISTANCE TOLL FREE TELEPHONE NUMBER**

**1.800.591.9360**

**TECHNICAL ASSISTANCE FAX: 1.626.855.4894**

#### **NOTES TO THE INSTALLER:**

- 1. Please leave this documentation with the owner of the fixture when finished.**
- 2. Please read this entire booklet before beginning the installation.**
- 3. Check your installation for compliance with plumbing, electrical, ANSI Z358.1 and other applicable codes.**

#### **LIMITED WARRANTY**

#### **UNITED STATES AND CANADA**


Acorn Safety warrants that its products are free from defects in material or workmanship under normal use and service for a period of one year from date of shipment or 18 months after the date of shipment from factory, whichever comes first. Acorn's liability under this warranty shall be discharged solely by replacement or repair of defective material, provided Acorn is notified in writing within one year from date of shipment, F.O.B. Industry, California.

This warranty does not cover installation or labor charges and does not apply to materials, which have been damaged by other causes such as mishandling or improper care or abnormal use. The repair or replacement of the defective materials shall constitute the sole remedy of the Buyer and the sole remedy of Acorn under this warranty. Acorn shall not be liable under any circumstances for incidental, consequential or direct charges caused by defects in materials, or any delay in the repair or replacement thereof. This warranty is in lieu of all other warranties expressed or implied. Product maintenance instructions are issued with each unit and disregard or non-compliance with these instructions will constitute an abnormal use condition and void the warranty. Stainless steel must be protected on job sites during construction and must be properly maintained after the water has been introduced into the safety product or Acorn's warranty is void.

**PRELIMINARY STEPS**

1. Read the installation instructions prior to beginning the installation.
2. Separate parts from packaging and verify all necessary parts are accounted for and undamaged. Obtain missing or damaged parts from Acorn Safety prior to beginning installation.
3. Flush water supply lines prior to installation. This will remove unwanted debris from the lines and prevent unwanted blockages in the safety equipment.
4. In order to comply with ANSI Z358.1, the safety equipment must be inspected periodically. An inspection tag is provided for documentation purposes.
5. all employees at risk of contamination should be informed and trained in the use of this and any other safety equipment. The signage provided should be posted appropriately in close proximity to this equipment.

**ROUGH-IN**

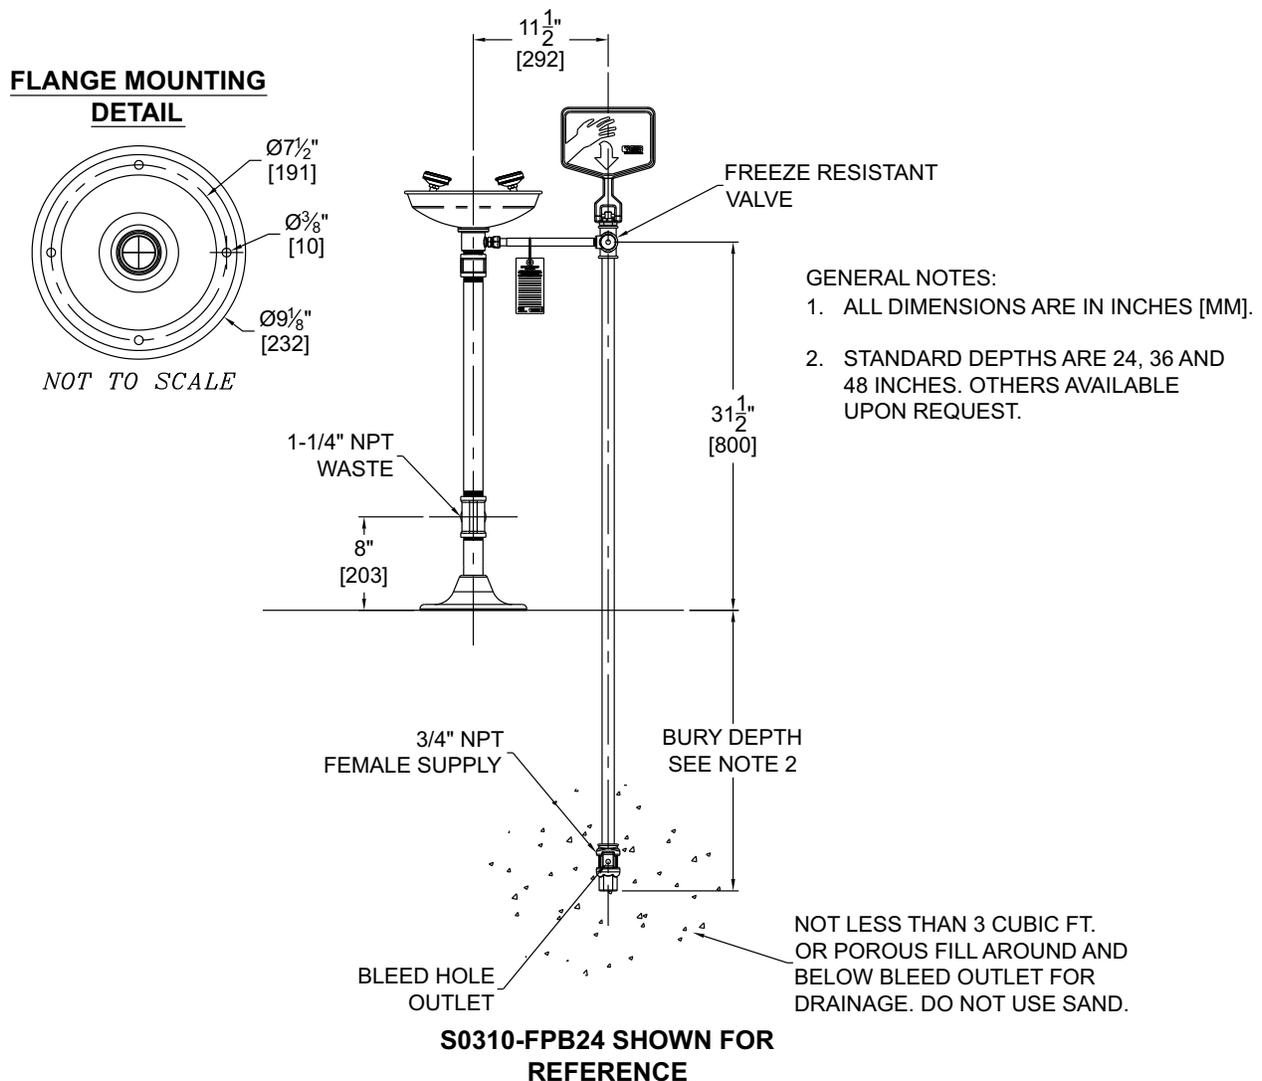

**INSTALLATION INSTRUCTIONS:**

Supplies required: (not provided by Acorn)

1. Floor fastener anchors, washers and bolts.
2. Pipe Sealant or Teflon tape for sealing water connections.

**IMPORTANT: Flush water supply lines prior to connection to safety equipment.**

**NOTES:**

- Top of spray nozzles must be between 33" - 45" from finished floor in order to meet ANSI Z358.1.
- Use hand tools and wrenches in a manner which will prevent marring finished surfaces. Strap wrenches or tools with plastic jaw linings are highly recommended.
- Refer to Rough-in for location of supply and drain lines.
- Fragments of Teflon tape or pipe sealant residue can interfere with the proper operation of this unit. Ensure pipe sealant methods do not cause contamination in the system.
- Prior to beginning assembly, TURN OFF water supply to 1-1/4" potable water supply line.

**STEP ONE: HYDRANT LOCATION**


1. Determine location of eyewash equipment and ensure to position equipment so that there is a minimum of 12" from any wall or equipment around assembled unit.
2. Determine frost line and dig pit deep enough to accommodate a minimum of 3 cubic feet of porous gravel fill.
3. Test hydrant for functionality before permanent placement. Place hydrant in proper location per rough-in drawing above. Hydrant valve body shall be buried within the gravel fill to insure proper drainage from weep holes. Connect customer supply line to hydrant and fill pit with 3 cubic feet of porous fill.
4. Back fill pit and create a concrete pad large enough for anchoring eyewash unit. Once concrete has completely cured, follow anchoring hardware instructions in step two.

**STEP TWO: PEDESTAL**

1. While holding the eyewash assembly (A) in position, mark mounting hole locations.
2. Remove flange assembly and install appropriate floor anchors to receive mounting bolts (supplied by others).
3. Re-position assembly and install with mounting bolts and washers.

**STEP THREE: HYDRANT CONNECTIONS**

1. Connect hydrant (B) to eyewash (A) assembly using 5/8" OD x 3/8" NPTE compression adapter provided & proper plumbing techniques to seal all made up threads.

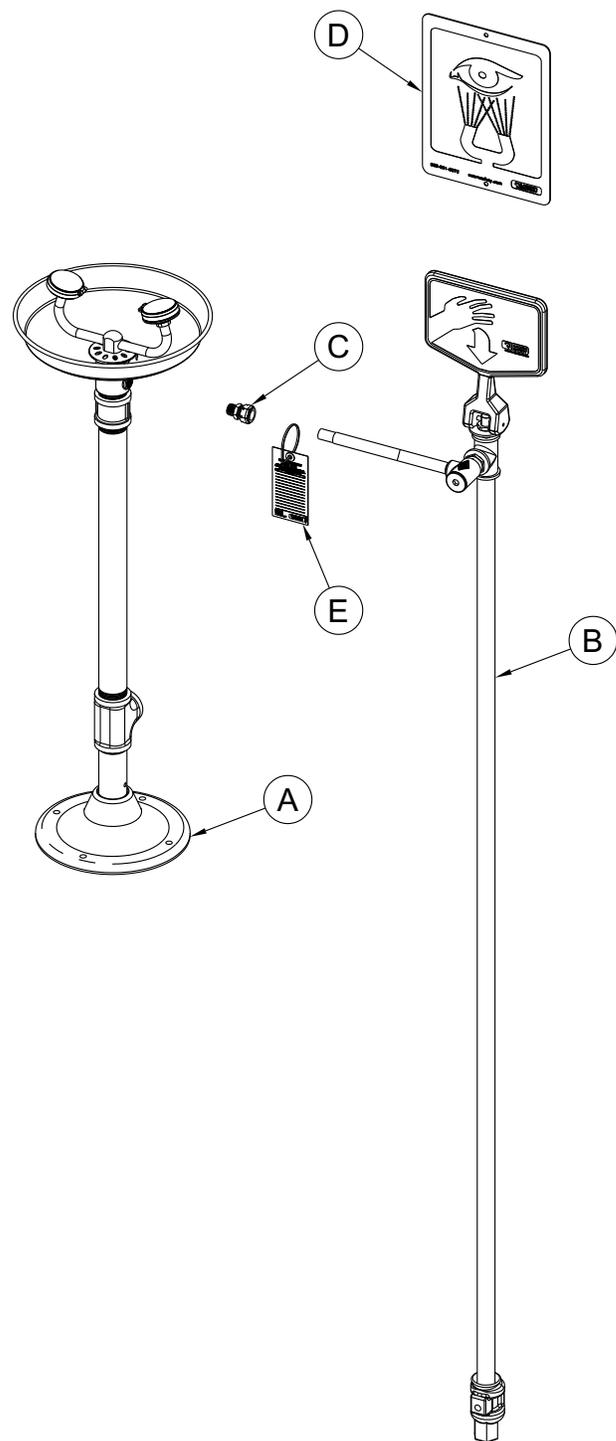

**INSTALLATION INSTRUCTIONS cont.:**

**Step Four: SANITARY DRAIN CONNECTION**

Note: Refer to Rough-ins for supply and drain line locations.


1. Install necessary pipe fittings (supplied by others) to make connection to 1-1/4" NPT waste tee with sanitary drain line.

**Step Five: TEST**

1. Turn on water supply to 3/4" potable water supply.
2. Inspect system for leaks.
3. Operate push handles on hydrant to verify that eyewash flows properly.
4. Shut off push handle and verify that the eyewash shuts off properly.

**Step Six: SIGNAGE AND INSPECTION TAG**

1. Install sign (D) with clear visibility as shown with appropriate hardware (supplied by others).
2. Attach inspection tag (E) supplied with plastic zip tie to 1/2" supply line as shown.

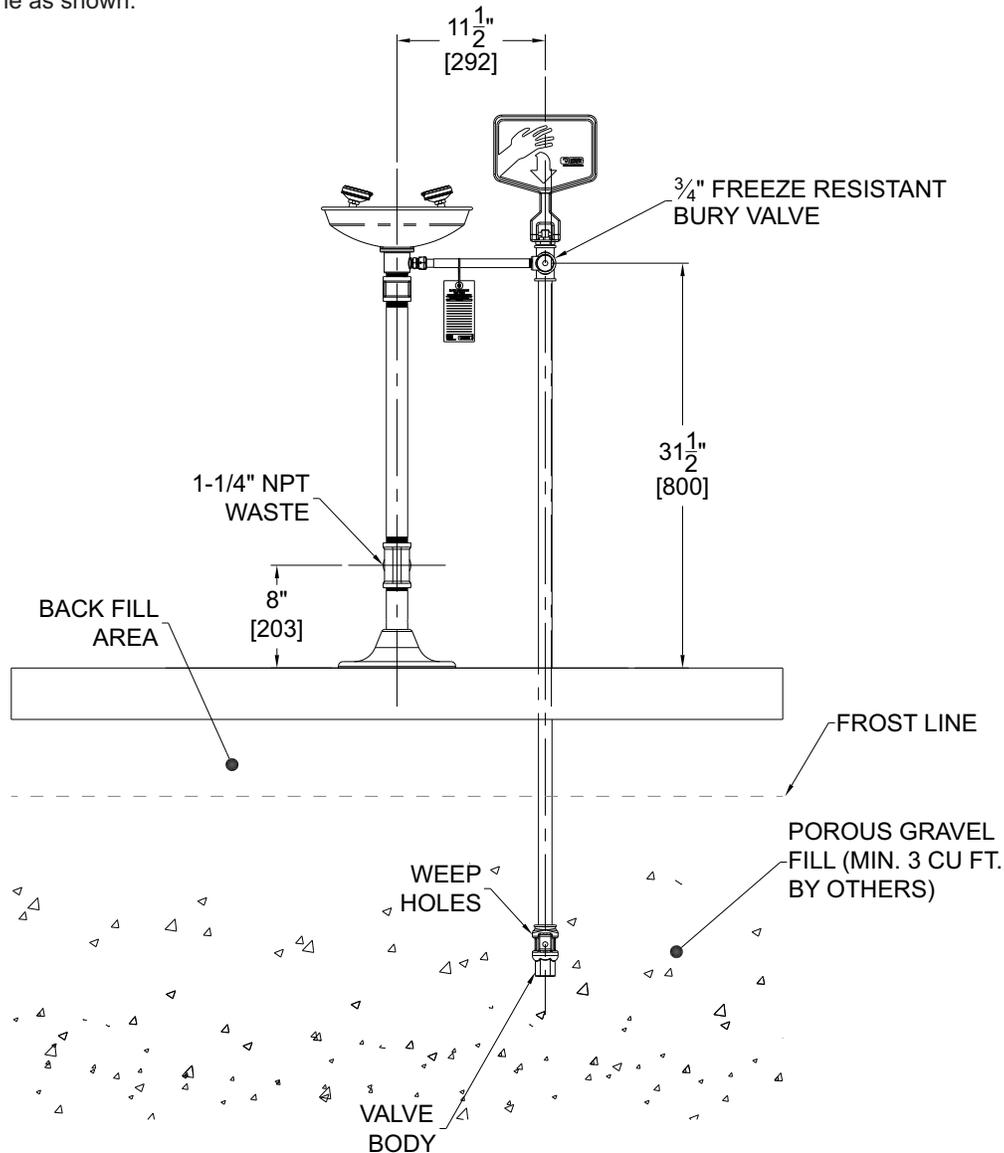

### **OPERATION INSTRUCTIONS:**

Employees who work with hazardous materials should become familiar with the location and operation of the nearest emergency plumbing fixture. Emergency plumbing fixtures stations are simple to use and require hands free operation once the station is activated.

Regular instruction regarding proper care and use will increase confidence that the units are accessible and function properly.

The route and area surrounding the Eye Wash should be clear and unobstructed; the sooner eyes are flushed, the less likelihood of damage. Eye Wash stations should be located in close proximity to the hazard and take no more than 10 seconds to reach. In the case of severe eye contamination the victim may require assistance to the Eye Wash station and help flushing their eyes.

Safety plumbing fixture equipment should be operated weekly for a period long enough to verify operation, clear the supply line of any sediment build-up and minimize microbial contamination due to sitting water.

1. To start the Eye Wash, swing spray nozzle assembly over the basin and push the paddle forward to the horizontal or fully "ON" position. Flushing should start, popping the spray nozzle caps open.
2. Lower both eyes into flow. Both eyes should be flushed to prevent contamination from one eye from being delivered to unaffected eye. Personnel who wear contact lenses should remove them immediately prior to or during the flush to prevent the contamination from remaining against the cornea possibly causing unnecessary damage or pain.
3. Using thumb and forefingers, fully open eyelids and flush eyes thoroughly for approximately 15 minutes or until medical personnel arrive. Be prepared to let the doctor know what type of contamination has entered the eye.
4. When finished return the push paddle to the vertical or fully "OFF" position and return spray nozzle assembly to standby position. Flushing fluid should stop. Once flushing fluid has stopped flowing, return spray nozzle lids to the closed position to protect from airborne contaminants.


### **MAINTENANCE GUIDE:**

Maintain and inspect in accordance with ANSI Z358.1-2009

1. Check for obvious signs of wear, broken or defective equipment. Re-paint if necessary. Replace missing or defective equipment such as broken push paddles, missing signs and inspection tags.
2. Remove strainer and washout any debris collected –replace as required.
3. Operate Eye Wash nozzles using the push paddle to place ball valve in the fully "ON" position checking for smooth operation of valve push paddle mechanism at the same time ensuring that the Eye Wash spray nozzle caps pop off immediately when actuated. If the ball valve does not operate smoothly check the actuating assembly for binding or missing parts. If the

**PARTS LIST**

ITEM #	PART NUMBER	DESCRIPTION
1	7101-031-022	BASE FLANGE SUB ASSEMBLY
2	7100-151-199	1-1/4" NPTE x 19-3/4" LONG GALV PIPE
3	7101-081-000	5/8" OD x 3/8" NPTE ADAPTER
4	7101-016-000	1/4" NPT COUPLING
5	7101-054-199	CASTING, DRAIN GASKET, SS BOWL, EYE/FACE WASH BOWL, EYE/FACE WASH
6	7101-046-00	
7	7101-008-000	STRAINER, EYE/FACE WASH
8	7100-108-199	INSPECTION TAG
9	7100-401-000	FPB EYE/FACE WASH ASSEMBLY
10	7107-142-001	1-1/4" NPTE x 18-3/8" LONG GALV PIPE
11	7100-180-022	HYDRANT ASSEMBLY, 3/4" NPT, 36" FPB
12	7107-162-001	EYEWASH SIGNAGE
13	7100-401-000	EYEWASH SIGNAGE

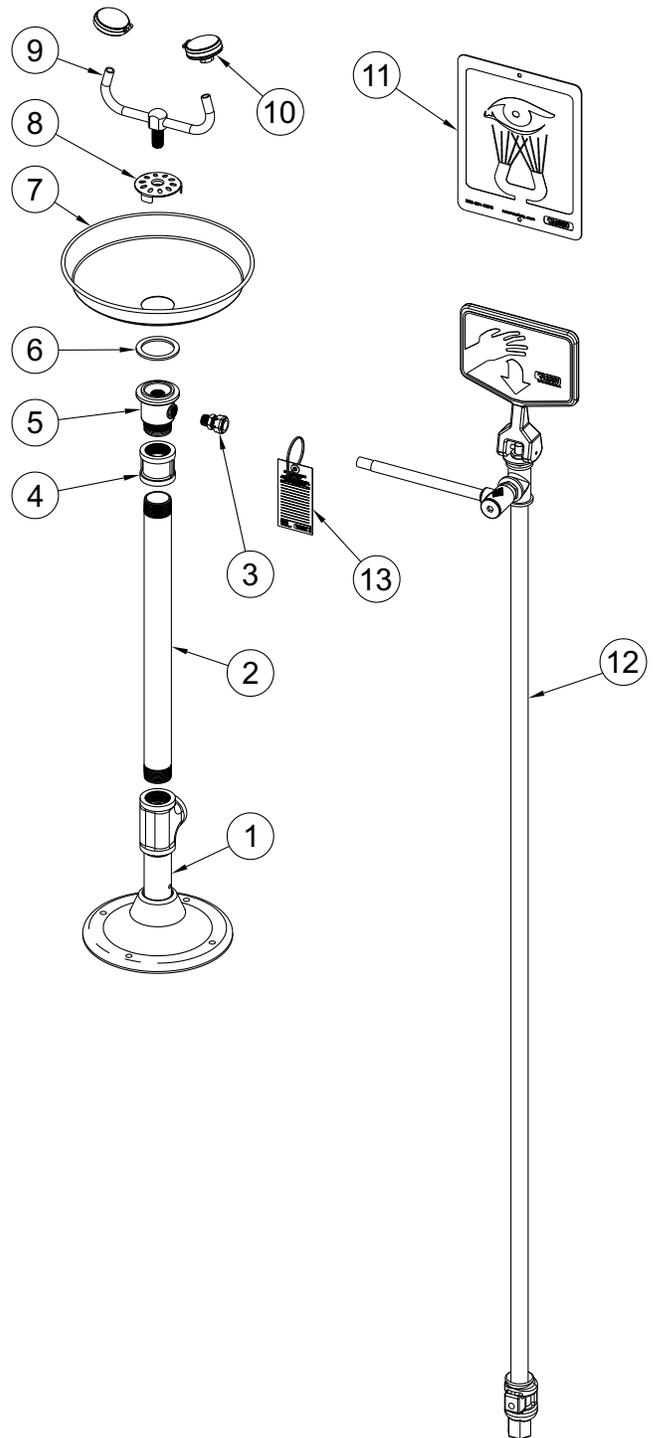

**PARTS LIST**

ITEM #	PART NUMBER	DESCRIPTION
1	7101-031-022	BASE FLANGE SUB ASSEMBLY
2	7100-151-199	1-1/4" NPTE x 19-3/4" LONG GALV PIPE
3	7101-081-000	5/8" OD x 3/8" NPTE ADAPTER
4	7101-016-000	1/4" NPT COUPLING
5	7101-054-199	CASTING, DRAIN GASKET, SS BOWL, EYE/FACE WASH BOWL, EYE/FACE WASH
6	7101-046-00	STRAINER, EYE/FACE WASH
7	7101-008-000	INSPECTION TAG
8	7100-108-199	FPB EYE/FACE WASH ASSEMBLY
9	7100-401-000	1-1/4" NPTE x 18-3/8" LONG GALV PIPE
10	7107-142-001	HYDRANT ASSEMBLY, 3/4" NPT FPB
11	7100-180-022	EYEWASH SIGNAGE
12	7107-162-001	EYEWASH SIGNAGE
13	7100-401-000	EYEWASH SIGNAGE

